ELECTRICAL SYMBOLS

MARK	DESCRIPTION
①	4-40 W CW-8 FT. WAKEFIELD PRISMATIC FLUORESCENT FIXTURE
②	2-40 W CW-4 FT. WAKEFIELD PRISMATIC FLUORESCENT FIXTURE
③	100 W INCANDESCENT WALL MOUNTED
④	150 W WEATHERTITE BRACKET LIGHT
EX	EXIST LIGHT – DAYBRITE SINGLE FACE 6" LETTERS
S1	SINGLE POLE TOGGLE SWITCH, 15AMP. SPEC. GRADE
S3	3-WAY TOGGLE SWITCH, 15 AMP. SPEC. GRADE
	DUPLEX RECEPTACLE, 15AMP. HUBBELL SPEC. GRADE

INSTALLATION

(a.) ALL ELECTRICAL WIRING SHALL BE COPPER, STRANDED, #12-600 VOLT THW INSULATION, INSTALLED IN THIN WALL RIDGID GALVANIZED CONDUIT. USE WATER TIGHT FITTINGS, CONNECTORS & BOX ENDS THROUGHOUT.

(b.) ALL EQUIPMENT SHALL BE GROUNDED; BOILER, WATER HEATER, PUMPS, ETC. TO THE BUILDING STEEL & TO THE GROUNDING IN THE EXISTING LAUNDRY BUILDING.

(c.) MOVE EXISTING PANEL "A" TO WEST WALL OF LAUNDRY ROOM & TIE IN ALL ACTIVE CIRCUITS. HOME RUNS FROM NEW ADDITION SHALL BE CONNECTED TO THIS PANEL.

(d.) INSTALL LIGHT SWITCHES 4'-0" ABOVE FLOOR, CONVENIENCE OUTLETS 1'-6" ABOVE FLOOR.

(e.) COMBINATION STARTERS FOR PUMP MOTORS SHALL BE SIZE 1 WITH THREE (3) OVERLOADS IN NEMA 12 ENCLOSURES.



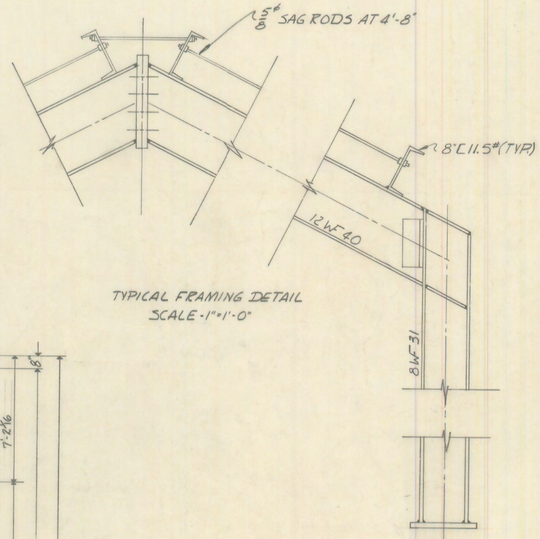

TYPICAL FRAMING DETAIL
SCALE: 1"=1'-0"

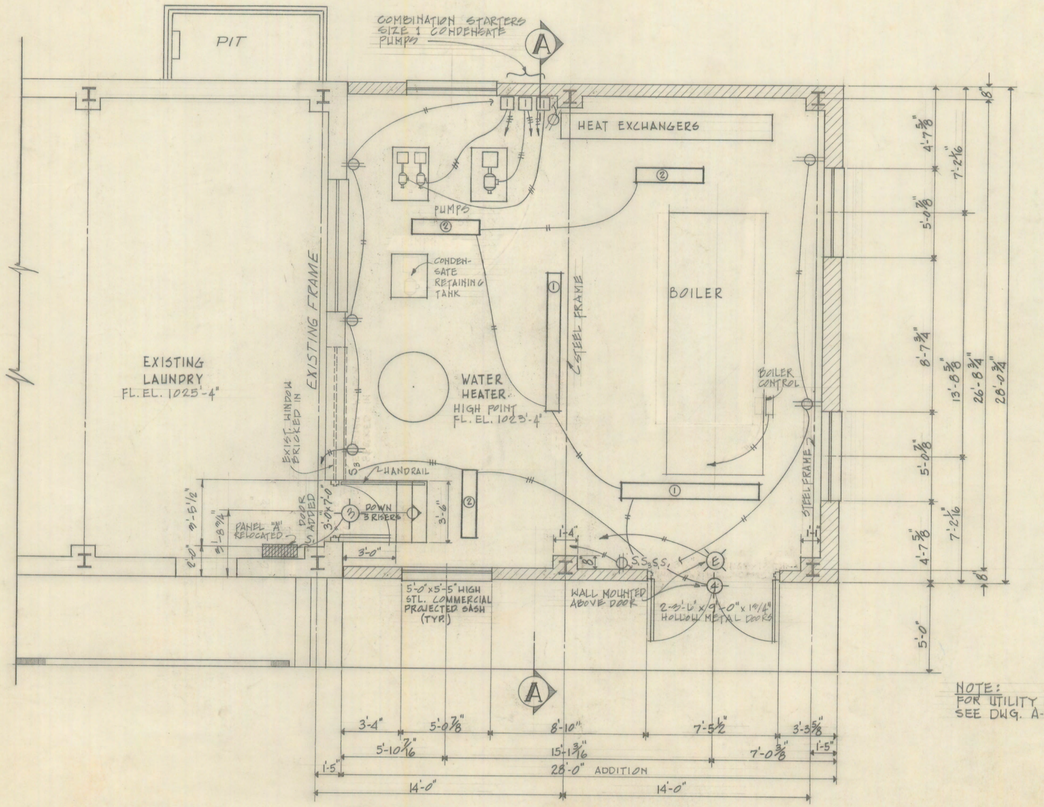

FLOOR PLAN
SCALE: ¼"=1'-0"

NOTE:
FOR UTILITY LINES, SEE DWG. A-2984, SHT. 2

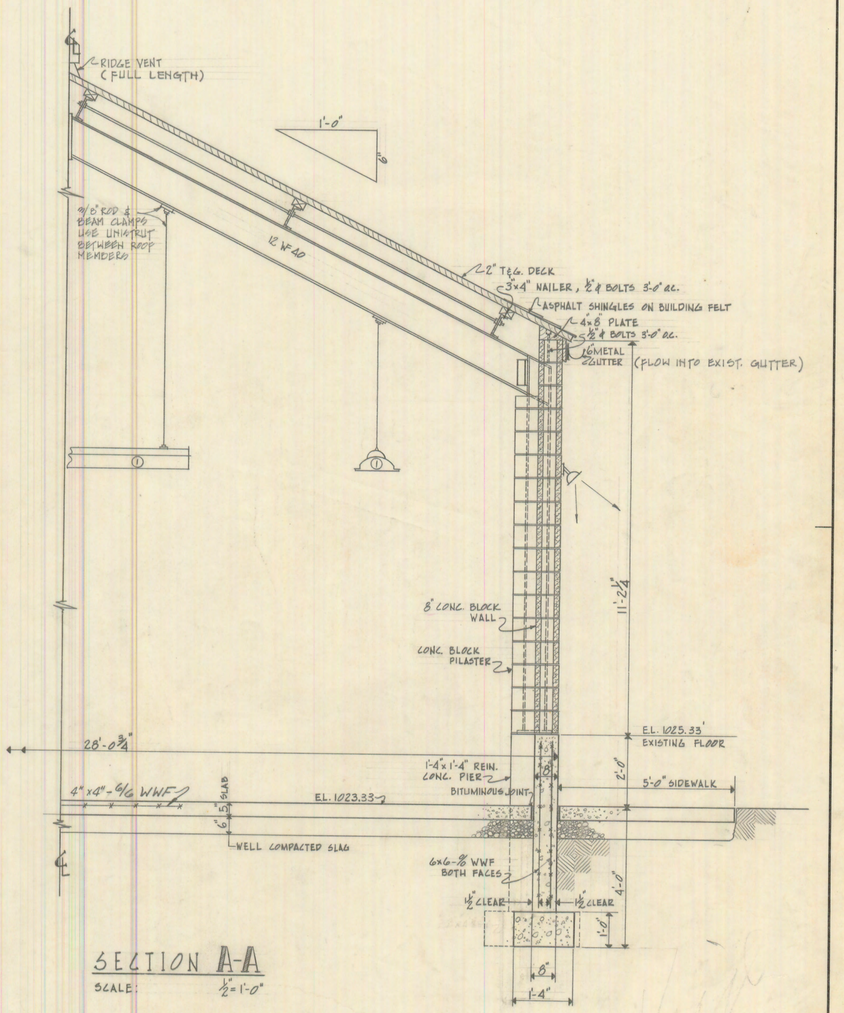

SECTION A-A
SCALE: ½"=1'-0"

ADDED ELEC. PLAN & SYMBOLS
MED 4-2-69

REV. 1	1	2	3	4 4-2-69	5	6

RAVENNA ARMY AMMUNITION PLANT
RAVENNA, OHIO
OPERATED BY RAVENNA ARSENAL, INC.

	APPROVED	SIGNATURE	DATE
1	SAFETY	O. D. Rastetter	2/24/69
2	TECHNICAL MANAGER		
3	PRODUCTION		
4	ENGINEERING	[illegible]	2/19/69
5	GENERAL MANAGER		
6	COMMANDING OFFICER		

TITLE: FLOOR PLAN & BUILDING SECTIONS
ADDITION TO LAUNDRY
ITEM #4
ADMINISTRATION AREA
BASE SUPPORT PROJECT

REF. DWG NO. 1012.201
DRWN. D. JENDRISAK | CHKD. FJG | ENGR. FJG
DATE 2-13-69
SCALE NOTED

A-2984-1

SHEET 1 OF 2