REVISIONS

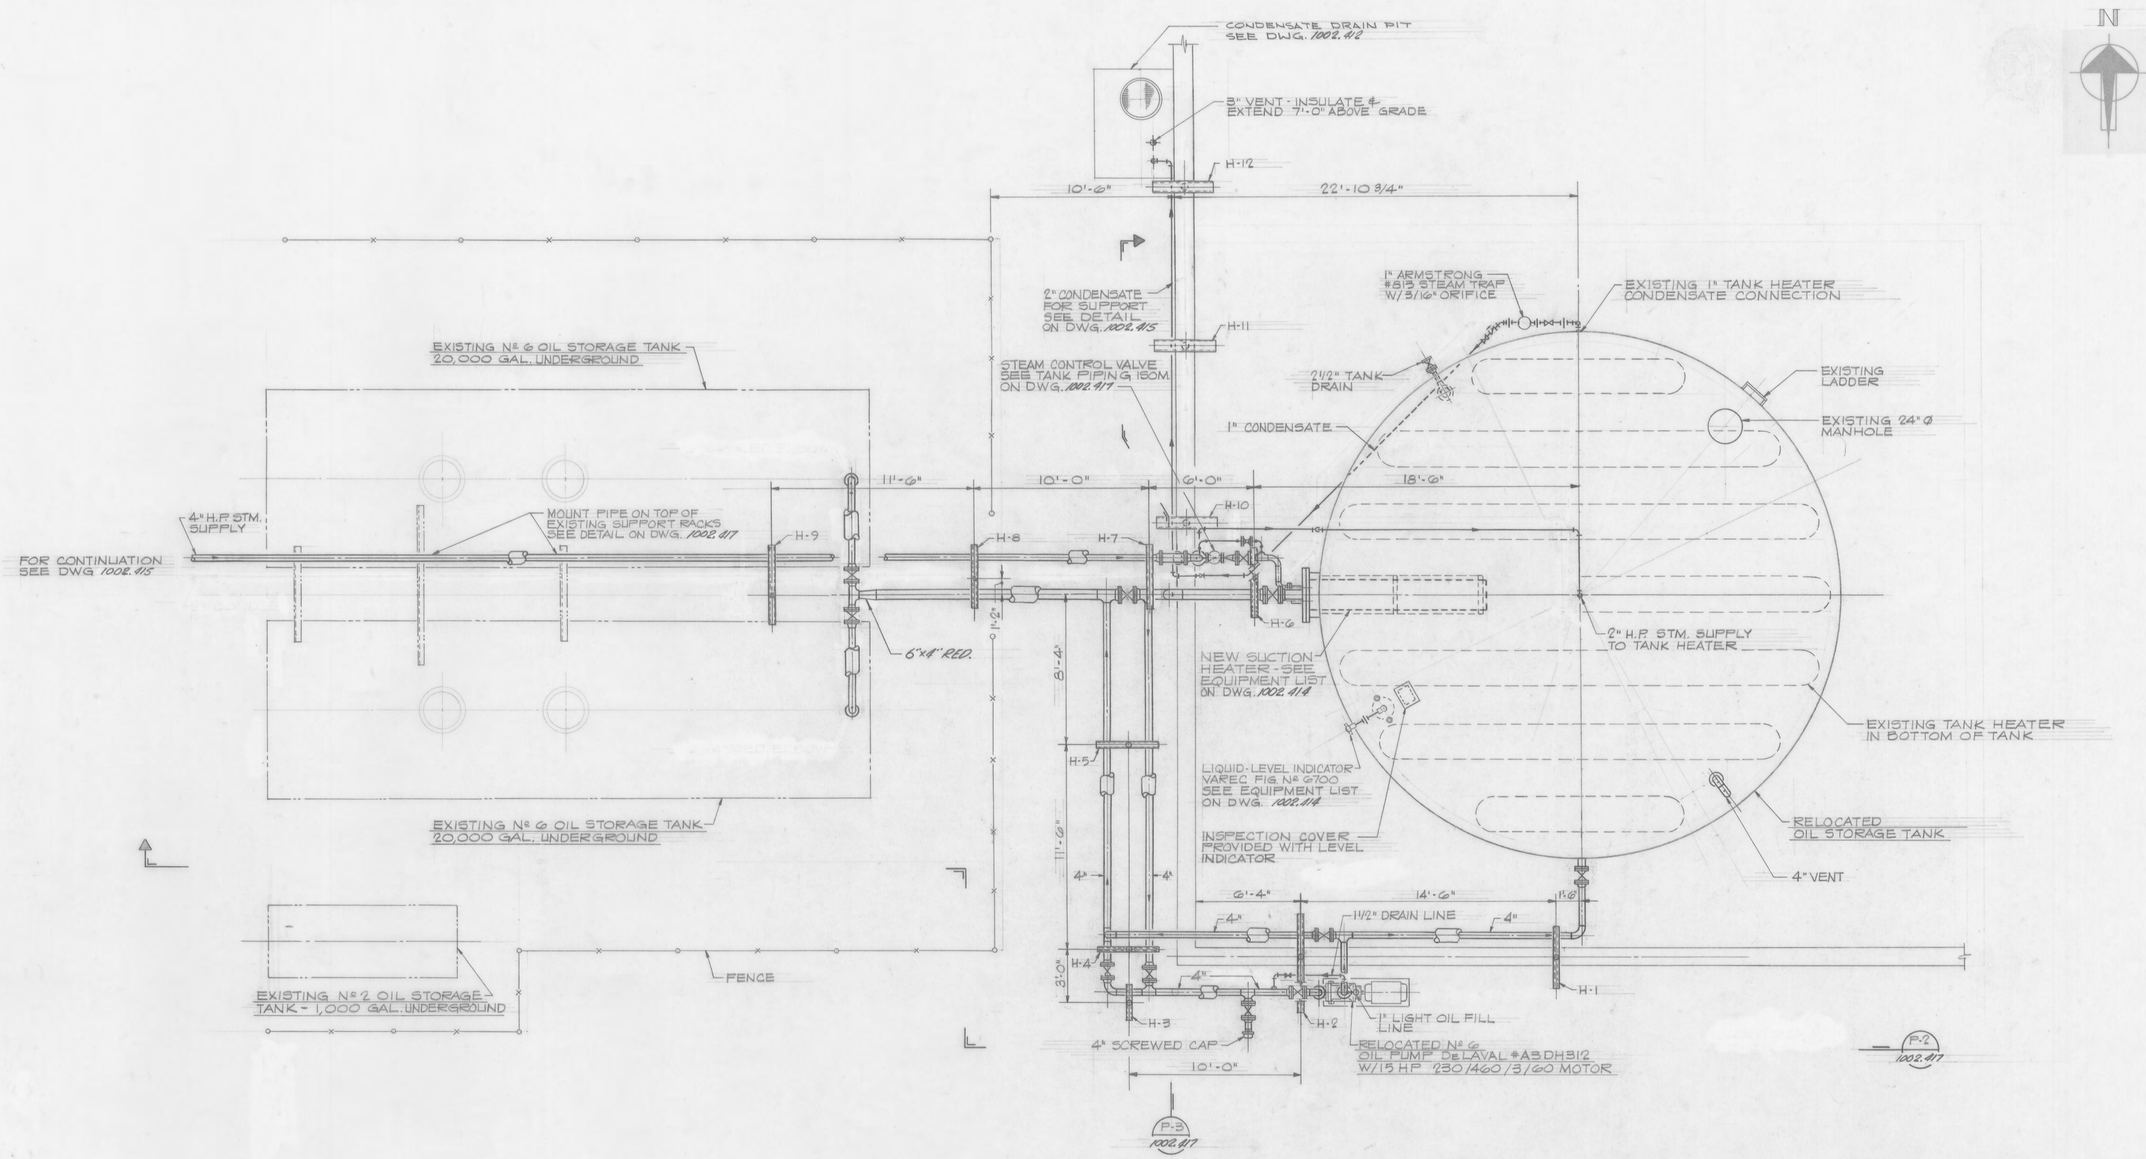

NOTES:

1. SLOPE FUEL OIL LINES DOWN TO UNDERGROUND TANKS AT 1/4" PER FT.
2. PITCH STEAM & CONDENSATE LINES IN DIRECTION OF FLOW AT 1" PER 40 FT.

REFERENCE DRAWINGS

1002.412 PIPE SUPPORT SCHEDULE & DETAILS
1002.414 TANK MODIFICATION DETAILS & EQUIPMENT LIST
1002.415 PIPING PLAN
1002.417 PIPING SECTIONS & DETAILS

STATE OF OHIO · WAYNE E. WELKER · 38613 · REGISTERED PROFESSIONAL ENGINEER

PREVIOUS STAFFORD ET AL. DWG. NO. 2749.

DETAIL NUMBER / LOCATION SHEET / DETAIL SHEET
DETAIL SYMBOL

VERIFY ALL DIMENSIONS AT THE SITE

STAFFORD · GIFFELS · BERGSTROM · FRICKER
ENGINEERS · ARCHITECTS · PLANNERS

DATE APRIL 1975	RAVENNA ARSENAL INC. RAVENNA OHIO	JOB NO. 75-11
SCALE 1/4" = 1'-0"	FUEL STORAGE TANK INSTALLATION	DRAWING NO. 1002.416
DRAWN BY N & B	PIPING PLAN	REV. ◇

K&E AKRON 12-73 MC1900•